DRAWING NUMBER | DRAWING NUMBER | DRAWING NUMBER | DRAWING NUMBER | DRAWING NUMBER

A-105
Coating, Filling and Sealing
105R-M1

IF THIS DRAWING IS NOT 30" x 42" IT IS A REDUCED PRINT. SCALE ACCORDINGLY

1/8"=1'-0" | 1/4"=1'-0" | 3/8"=1'-0" | 1/2"=1'-0" | 3/4"=1'-0" | 1"=1'-0" | 1-1/2"=1'-0" | 3"=1'-0"

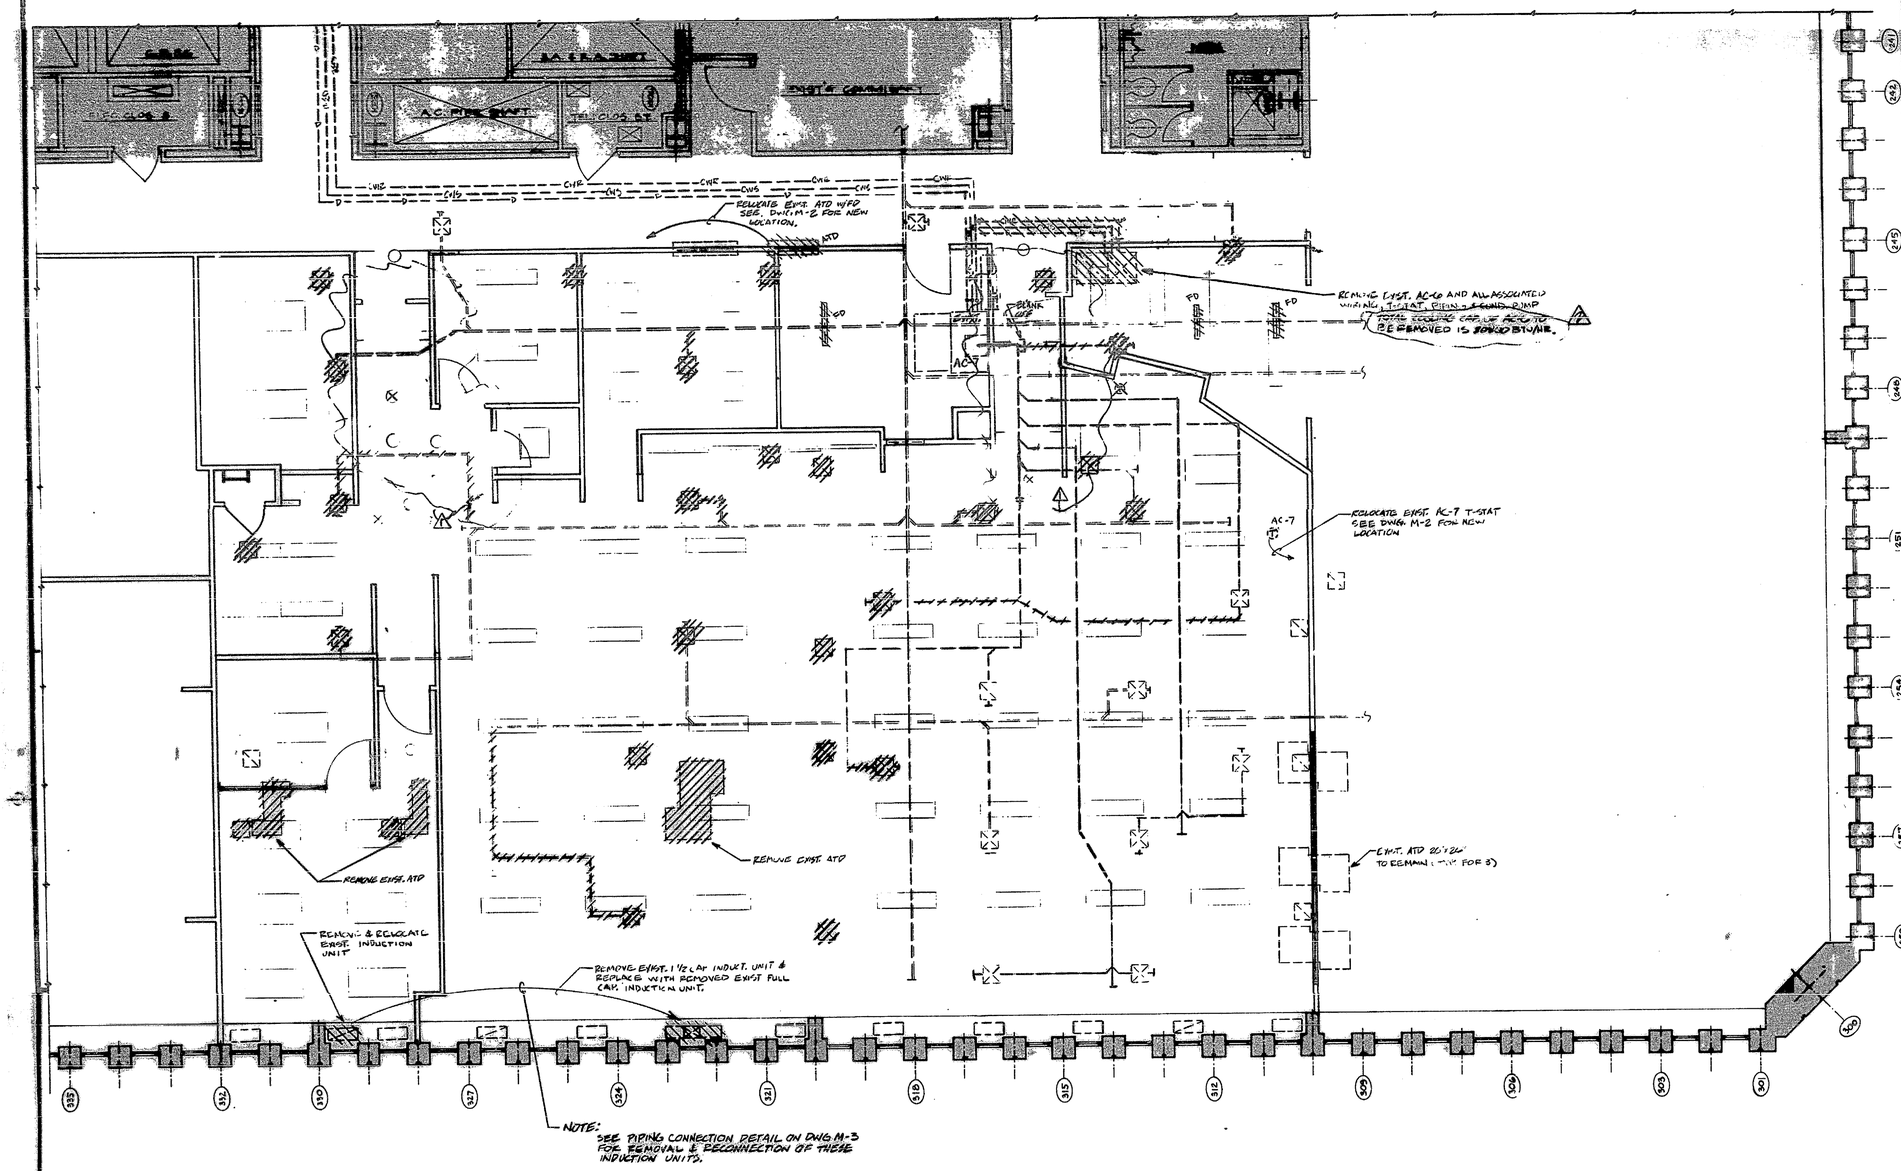

PLAN VIEW

LEGEND

- EXISTING DUCTWORK SUPPLEMENTAL COOLING TO REMAIN
- EXISTING BASE BUILDING DUCTWORK TO REMAIN
- EXISTING DUCTWORK SUPPLEMENTAL COOLING TO BE REMOVED
- EXISTING BASE BUILDING DUCTWORK TO BE REMOVED
- EXISTING SUPPLY AIR DIFFUSER TO REMAIN
- EXISTING SUPPLY AIR DIFFUSER TO BE REMOVED OR RELOCATED
- EXISTING RETURN AIR GRILLE TO REMAIN
- EXISTING RETURN AIR GRILLE TO BE REMOVED
- FD — EXISTING FIRE DAMPER TO BE REMOVED
- ATD — EXISTING AIR TRANSFER DUCT AND FIRE DAMPER TO BE RELOCATED
- EXISTING CEILING MOUNTED AC UNIT TO BE REMOVED
- EXISTING FULL CAPACITY INDUCTION UNIT TO REMAIN
- EXISTING 1/2 CAPACITY INDUCTION UNIT TO REMAIN
- EXISTING 1/2 CAPACITY INDUCTION UNIT TO BE RELOCATED
- EXISTING 1 1/2 CAPACITY INDUCTION UNIT TO BE REMOVED
- EXISTING THERMOSTAT TO BE REMOVED
- T — EXISTING THERMOSTAT TO BE RELOCATED
- CWS — EXISTING CONDENSER WATER SUPPLY TO REMAIN
- CWR — EXISTING CONDENSER WATER RETURN TO REMAIN
- D — EXISTING CONDENSATE DRAIN PIPING TO REMAIN
- CWS — EXISTING CONDENSER WATER SUPPLY TO BE REMOVED
- CWR — EXISTING CONDENSER WATER RETURN TO BE REMOVED
- D — EXISTING CONDENSATE DRAIN PIPING TO BE REMOVED

JUNIUS PS ARCHITECTS
908 LEXINGTON AVE.
NEW YORK NY 10006
TEL (212) 888-8250

JOHN C. WESTRICK & ASSOCIATES
CONSULTING ENGINEERS
211Ø MAPLE AVE. SOUTH PLAINFIELD, N.J.
07080 908 561-4170

DATE	ISSUED TO	PR	TR
4/28/92	PORT AUTHORITY FOR APPROVAL	1	-
4/28/92	C.F.S.C.	2	-
6-10-92	PORT AUTHORITY FOR APPROVAL	12	-
8-26-92	PORT AUTHORITY FOR APPROVAL	13	

NO	DATE	REVISION	BY
2	8-24-92	REVISED PER P.A. COMMENTS	PE
1	6-8-92	REVISED PER P.A. COMMENTS	JW



KEY PLAN
1/64"=1'-0"

CANTOR, FITZGERALD SECURITIES CORP.
105th FLOOR
ONE WORLD TRADE CENTER, NEW YORK N.Y.

PROPOSED ALTERATION TO G.S.B. TRADING ROOM
MECHANICAL DEMOLITION PLAN

NORTH

PROJECT NO.	92119
SCALE	1/8"=1'-0
DRAWN BY	PE
CHECKED BY	JCW
DATE	4/27/92

DRAWING NO.
105R-M1

T.A.A. NO.